

AMENDMENT OF SOLICITATION/MODIFICATION OF CONTRACT

1. CONTRACT ID CODE	PAGE	OF	PAGES
---------------------	------	----	-------

2. AMENDMENT/MODIFICATION NO.	3. EFFECTIVE DATE	4. REQUISITION/PURCHASE REQ. NO.	5. PROJECT NO. (If applicable)
-------------------------------	-------------------	----------------------------------	--------------------------------

6. ISSUED BY CODE	7. ADMINISTERED BY (If other than Item 6) CODE
---	--

8. NAME AND ADDRESS OF CONTRACTOR (No., street, county, State and ZIP Code)	(X)	9A. AMENDMENT OF SOLICITATION NO.
		9B. DATED (SEE ITEM 11)
		10A. MODIFICATION OF CONTRACT/ORDER NO.
		10B. DATED (SEE ITEM 11)

CODE	FACILITY CODE
------	---------------

11. THIS ITEM ONLY APPLIES TO AMENDMENTS OF SOLICITATIONS

The above numbered solicitation is amended as set forth in Item 14. The hour and date specified for receipt of Offers is extended, is not extended. Offers must acknowledge receipt of this amendment prior to the hour and date specified in the solicitation or as amended, by one of the following methods:

(a) By completing items 8 and 15, and returning _____ copies of the amendment; (b) By acknowledging receipt of this amendment on each copy of the offer submitted; or (c) By separate letter or telegram which includes a reference to the solicitation and amendment numbers. FAILURE OF YOUR ACKNOWLEDGMENT TO BE RECEIVED AT THE PLACE DESIGNATED FOR THE RECEIPT OF OFFERS PRIOR TO THE HOUR AND DATE SPECIFIED MAY RESULT IN REJECTION OF YOUR OFFER. If by virtue of this amendment your desire to change an offer already submitted, such change may be made by telegram or letter, provided each telegram or letter makes reference to the solicitation and this amendment, and is received prior to the opening hour and date specified.

12. ACCOUNTING AND APPROPRIATION DATA (If required)

13. THIS ITEM ONLY APPLIES TO MODIFICATION OF CONTRACTS/ORDERS. IT MODIFIES THE CONTRACT/ORDER NO. AS DESCRIBED IN ITEM 14.

CHECK ONE	A. THIS CHANGE ORDER IS ISSUED PURSUANT TO: (Specify authority) THE CHANGES SET FORTH IN ITEM 14 ARE MADE IN THE CONTRACT ORDER NO. IN ITEM 10A.
	B. THE ABOVE NUMBERED CONTRACT/ORDER IS MODIFIED TO REFLECT THE ADMINISTRATIVE CHANGES (such as changes in paying office, appropriation date, etc.) SET FORTH IN ITEM 14, PURSUANT TO THE AUTHORITY OF FAR 43.103(b).
	C. THIS SUPPLEMENTAL AGREEMENT IS ENTERED INTO PURSUANT TO AUTHORITY OF:
	D. OTHER (Specify type of modification and authority)

E. IMPORTANT: Contractor is not, is required to sign this document and return _____ copies to the issuing office.

14. DESCRIPTION OF AMENDMENT/MODIFICATION (Organized by UCF section headings, including solicitation/contract subject matter where feasible.)

Except as provided herein, all terms and conditions of the document referenced in Item 9A or 10A, as heretofore changed, remains unchanged and in full force and effect.

15A. NAME AND TITLE OF SIGNER (Type or print)	16A. NAME AND TITLE OF CONTRACTING OFFICER (Type or print)
15B. CONTRACTOR/OFFEROR (Signature of person authorized to sign)	15C. DATE SIGNED
16B. UNITED STATES OF AMERICA (Signature of Contracting Officer)	16C. DATE SIGNED

10-0031 Repair BEQ Building BB260 Temporary Trailer Telecommunications Requirements


Section 01 59 00 Temporary Trailers for Displaced Tenants

2.1 Trailer

2.1.1.

o. Contractor shall install 1-4" Conduit, with Outside Plant 12 strand shielded fiber with Corning glass and Outside Plant PE-39 25 pair copper cable, from the center telecommunications trailer to Man Hole 6-2-1. See attached sketch of new 4" conduit, per contractor, and existing conduit. The exact location of new and existing shall be determined/located by contractor. The contractor is responsible for surveying the work area to locate all existing utilities. The contractor is responsible for any damage done to the existing utilities. The contractor shall install/extend the new Outside Plant 12 strand shielded fiber with Corning glass and Outside Plant PE-39 25 pair copper, in the existing conduit, from Man Hole 6-2-1 to the existing telecommunications room 154 in BB260 and terminate on rack/cabinet at both ends. The contractor shall adhere to 33 82 00 Telecommunications Outside Plant specifications for proper installation of conduits. Conduits shall terminate underneath the center trailer (near telecomm cabinet). Preserve and protect the existing outside plant (OSP) telecommunications. The contractor is responsible for all telecommunications pathway and infrastructure. The contractor is to ensure that the temporary trailers have a complete and usable telecommunications system. Once construction has been completed the contractor shall remove cabling, conduit, and equipment that was previously provided by contractor.

Provide a separate 4" PVC conduit underground from telecomm trailer to other trailers for telecommunications cabling installation/pathway. Conduits shall be installed after trailers have been placed and set up. Conduits shall use long sweeps at all changes of direction. Inside radius of conduit shall be at least 24". Conduits shall have no more than 180 degrees of total change in direction. Conduits shall be installed with pull wire accessible from both ends and both ends shall be capped.

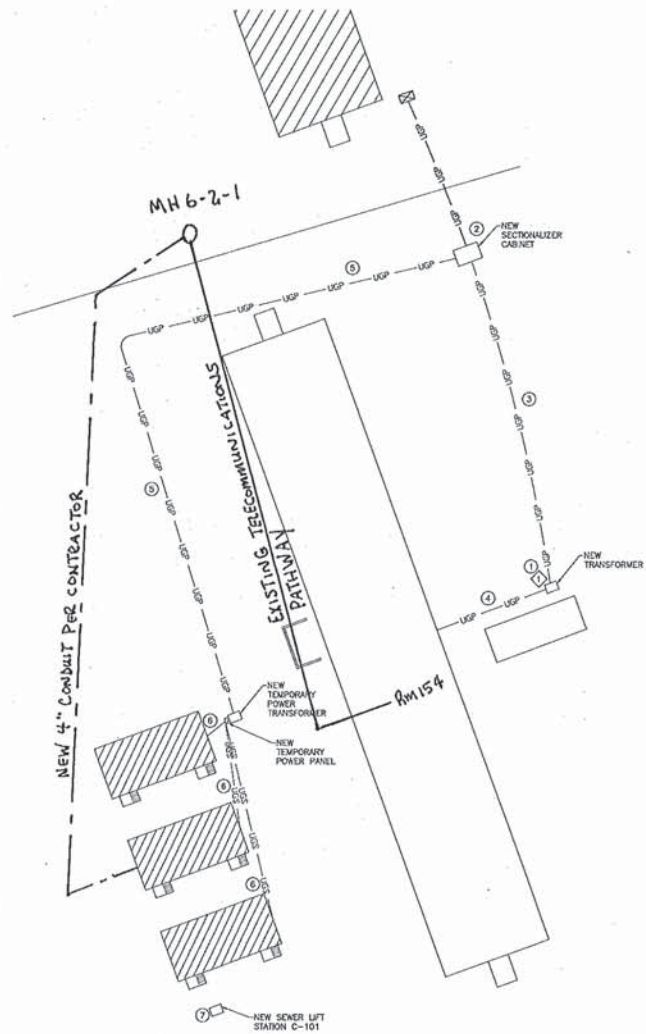

SITE ELECTRICAL DEMOLITION & NEW WORK PLAN
 SCALE: 1" = 20'

20' 0 20' 40'
 SCALE: 1" = 20'
 GRAPHIC SCALE

GENERAL NOTES:

1. SEE RISER DIAGRAM ON SHEET E-603 FOR WIRING REQUIREMENTS.
2. COORDINATE TRAILER COMMUNICATION REQUIREMENTS TO INCLUDE BUT NOT LIMITED TO NUMBER OF CONDUITS AND PROPS, WITH BASE TELEPHONE COMMUNICATIONS DIVISION AT 910-451-9439 OR 910-451-4760.
3. PROVIDE ALL COMMUNICATIONS CABLING, EQUIPMENT, AND JACK SET ASSEMBLIES ASSOCIATED WITH OFFICE AREAS AND AREAS SERVICED BY BASE TELEPHONE SYSTEM PER CAMP LEAGUE COMMUNICATIONS SPECIFICATION 27 TO DO. ALL WORK SHALL BE DONE BY A QUALIFIED COMMUNICATIONS SUBCONTRACTOR, CONTACT BASE TELEPHONE REGARDING ANY COMMUNICATIONS QUESTIONS AT 910-451-9439 OR 910-451-4760.

DEMOLITION KEY NOTES:

- ① DISCONNECT AND PRESERVE EXISTING PRIMARY CONDUCTORS FEEDING EXISTING TRANSFORMER. IDENTIFY AND TAG CABLES FOR RE-USE. REMOVE EXISTING PAD-MOUNTED TRANSFORMER AND PAD COMPLETE. REMOVE EXISTING SERVICE FEEDER. CONDUITS AND DISCONNECTS TO BUILDINGS BR260 AND BR261 COMPLETE.

NEW WORK KEYNOTES:

- ① INSTALL NEW 750KVA, 12.47KV-208Y/120V PAD-MOUNTED TRANSFORMER WITH NEW CONCRETE PAD.
- ② INTERCEPT EXISTING UNDERGROUND PRIMARY. PROVIDE NEW SECTIONALIZER CABINET AT LOCATION INDICATED. RE-USE PRESERVED PRIMARY CONDUCTORS FOR CONNECTION TO SECTIONALIZER CABINET. SEE SECTIONALIZER CABINET DETAIL ON SHEET E-603.
- ③ PROVIDE NEW UNDERGROUND PRIMARY CONDUCTORS TO NEW SERVICE TRANSFORMER FOR BUILDING BR260.
- ④ INSTALL NEW UNDERGROUND SERVICE TO BR260.
- ⑤ INSTALL NEW UNDERGROUND PRIMARY POWER FROM NEW SECTIONALIZER CABINET TO NEW TEMPORARY POWER SINGLE PHASE TRANSFORMER. SEE RISER DIAGRAM ON SHEET E-603 FOR WIRING REQUIREMENTS.
- ⑥ INSTALL NEW TEMPORARY SECONDARY SERVICE TO EACH TRAILER. SEE RISER DIAGRAM ON SHEET E-603 FOR WIRING REQUIREMENTS.
- ⑦ GENERATOR PUMPS BY SEWER LIFT STATION TO BE FED FROM TRAILER TEMPORARY POWER PANEL. SEE SHEET E-602.

EQUIPMENT SCHEDULE		
EQUIPMENT	FEEDER	DISCONNECT
SEWER PUMPS	#210, #100, #100, 1/2" C	VIA CONTROL PANEL

CEMIS <small>CONSULTING ENGINEERING & MANAGEMENT SERVICES</small> 1000 W. HARRIS STREET SUITE 100 WARRINGTON, NC 27888 (919) 853-1111 FAX (919) 853-1112		ES-101
		EQUIPMENT OF THE BUILT MARINE CORPS BASE CAMP LEJEUNE, NORTH CAROLINA
DR. R. ALVAR CHIEF ENGINEER DATE:		REPAIR BEO BUILDING 8B260
SUBMITTED BY: DESIGN BY: APPROVED PWD OR ODC:		SITE ELECTRICAL DEMOLITION & NEW WORK PLAN DRAWING NO. 60007622 DATE:
SATISFACTORY TO:		SCALE: